



2013-2014 Wet Weather WQO Ratios  
for S13 Coyote Creek at Spring St.

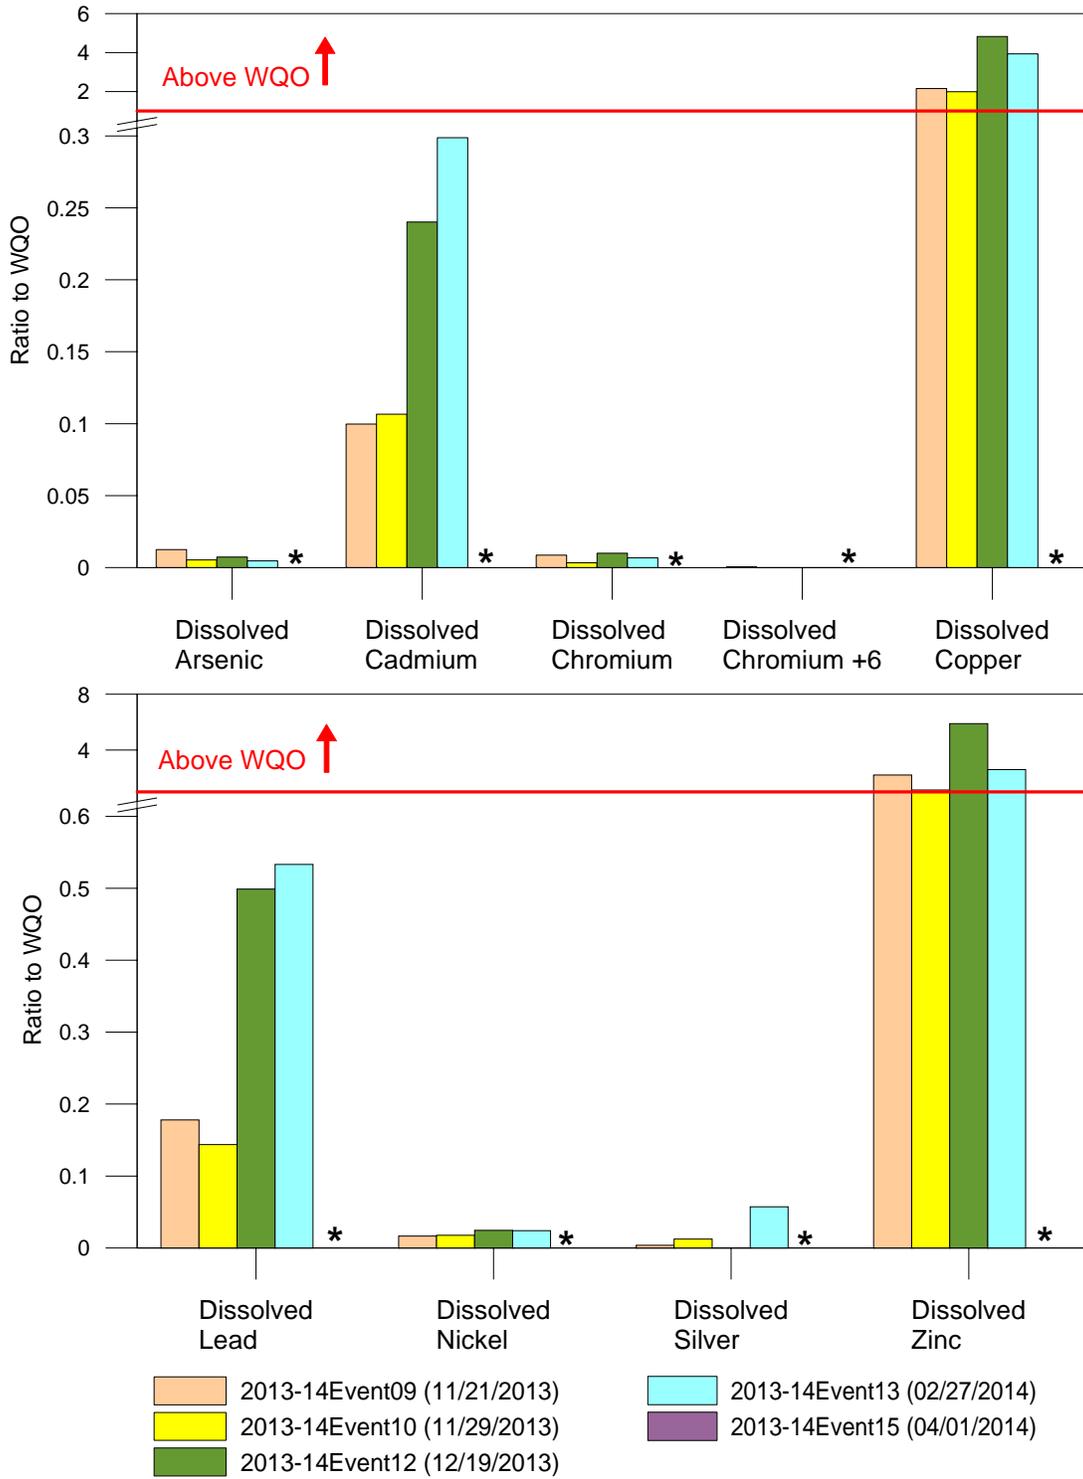

\*Samples were not collected for dissolved metals during Event 15.

Figure 4-3.4 S13 Coyote Creek at Spring St Wet Weather Ratio Plots

**2013-2014 Wet Weather WQO Ratios  
for S13 Coyote Creek at Spring St.**

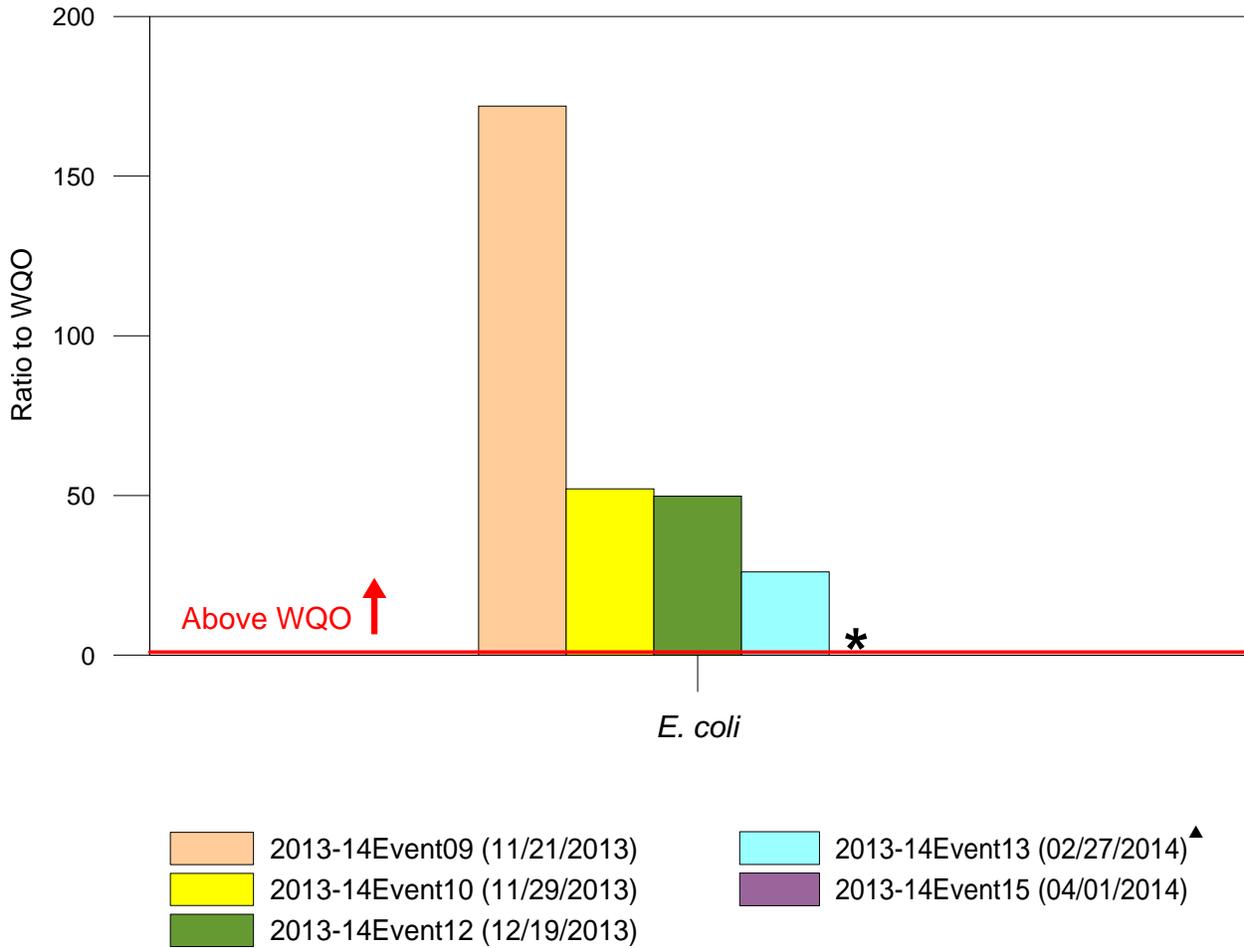


\*Samples were not collected for fecal coliforms during Event 15.

▲ Not an exceedance of the *E. coli* water quality objective due to the High Flow Suspension of Recreational Uses (LARWQCB, 2003).

Figure 4-3.4 S13 Coyote Creek at Spring St Wet Weather Ratio Plots

**2013-2014 Wet Weather WQO Ratios  
for S13 Coyote Creek at Spring St.**

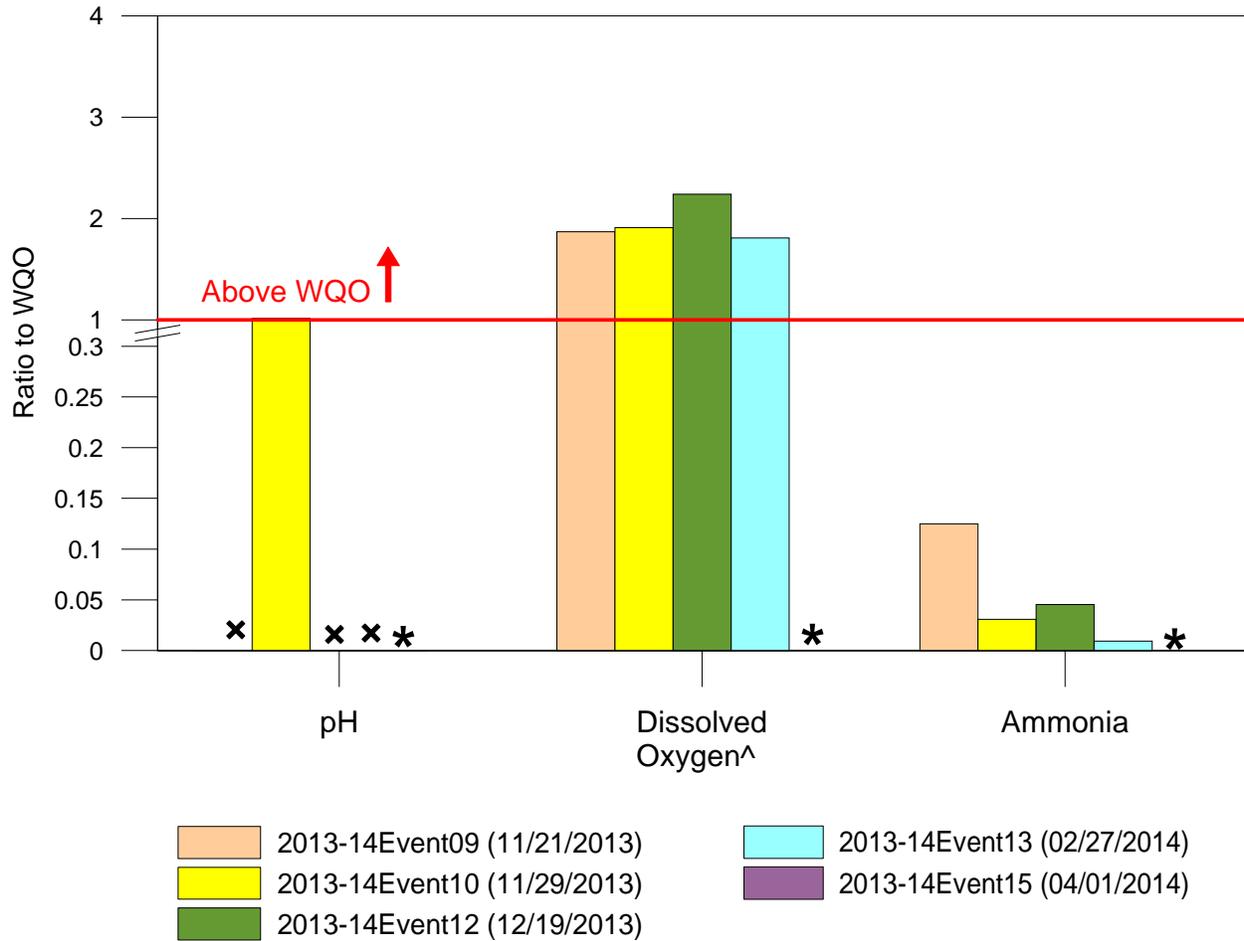

<sup>^</sup>Dissolved oxygen is an exceedance if ratio to WQO is below 1.

× pH was within WQO range.

\*Samples were not collected for ammonia, dissolved oxygen, or pH during Event 15.

Figure 4-3.4 S13 Coyote Creek at Spring St Wet Weather Ratio Plots