
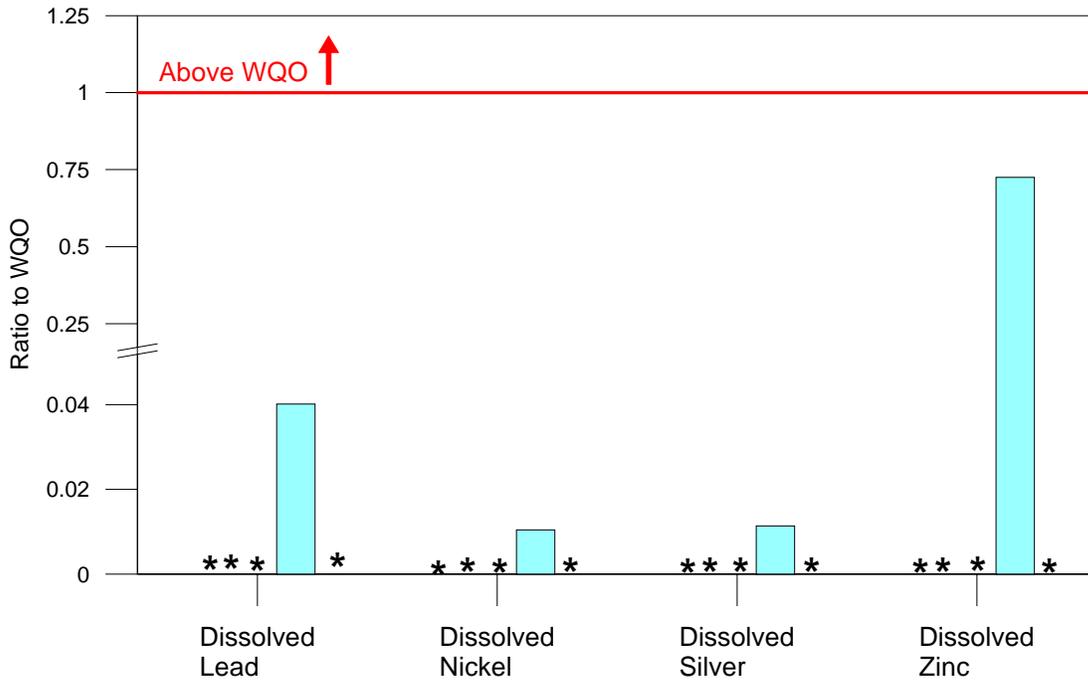



**2013-2014 Wet Weather WQO Ratios
for TS30 PD 728 at Foxfield Dr.**

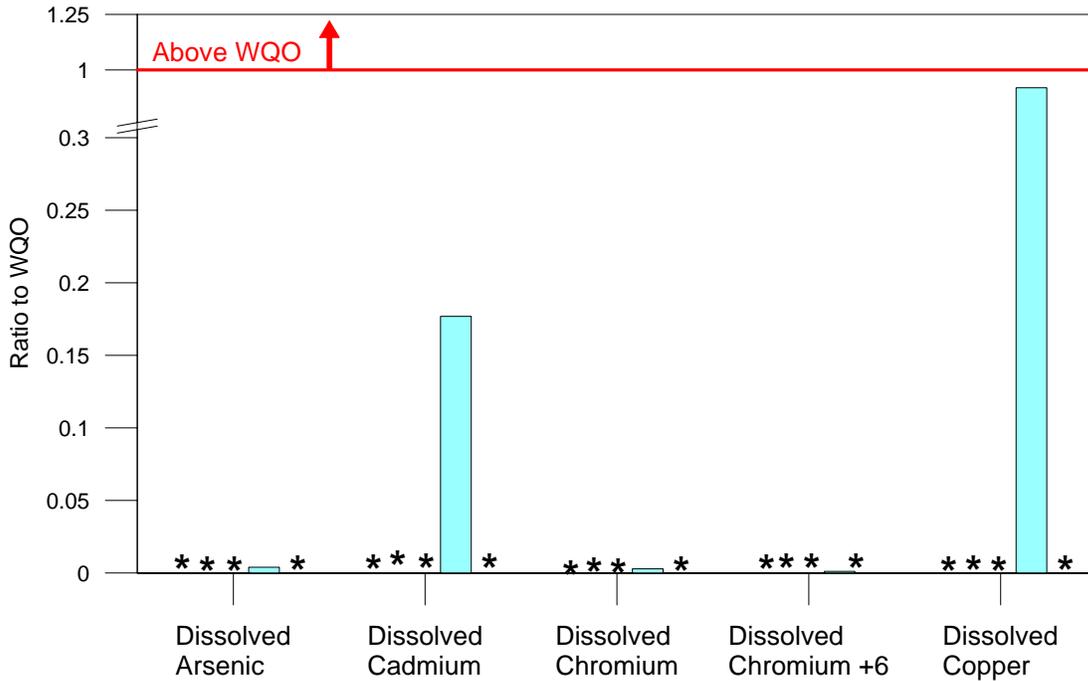

* Samples were not collected for dissolved metals during Event 09, Event 10, Event 12, and Event 15.

Figure 4-4.6 TS30 PD 728 at Foxfield Dr. Wet Weather Ratio Plots


**2013-2014 Wet Weather WQO Ratios
for TS30 PD 728 at Foxfield Dr.**

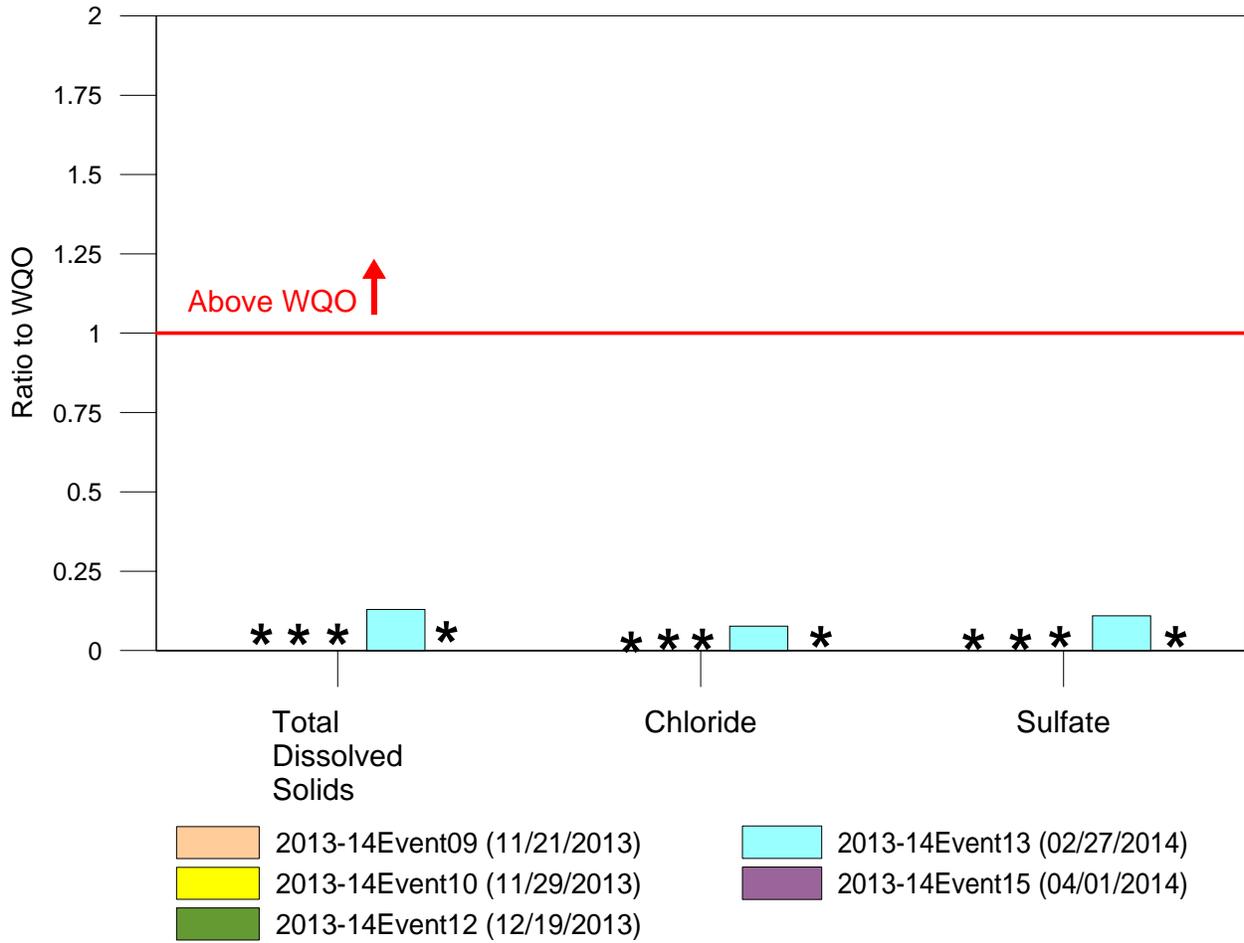

*Samples were not collected for chloride, sulfate, or total dissolved solids during Event 09, Event 10, Event 12, and Event 15.

Figure 4-4.6 TS30 PD 728 at Foxfield Dr. Wet Weather Ratio Plots

**2013-2014 Wet Weather WQO Ratios
for TS30 PD 728 at Foxfield Dr.**

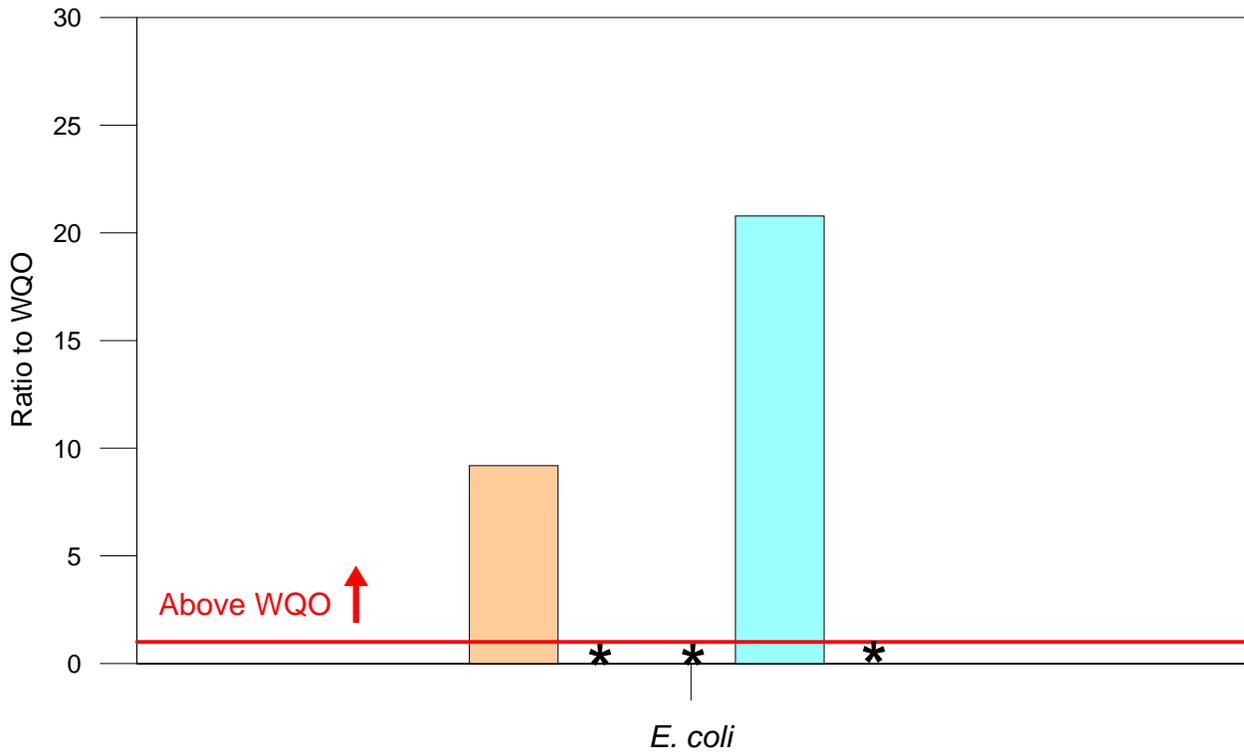


- | | |
|---|--|
|  2013-14Event09 (11/21/2013) |  2013-14Event13 (02/27/2014) |
|  2013-14Event10 (11/29/2013) |  2013-14Event15 (04/01/2014) |
|  2013-14Event12 (12/19/2013) | |

*Samples were not collected for fecal coliforms during Event 10, Event 12, and Event 15.

Figure 4-4.6 TS30 PD 728 at Foxfield Dr. Wet Weather Ratio Plots

**2013-2014 Wet Weather WQO Ratios
for TS30 PD 728 at Foxfield Dr.**

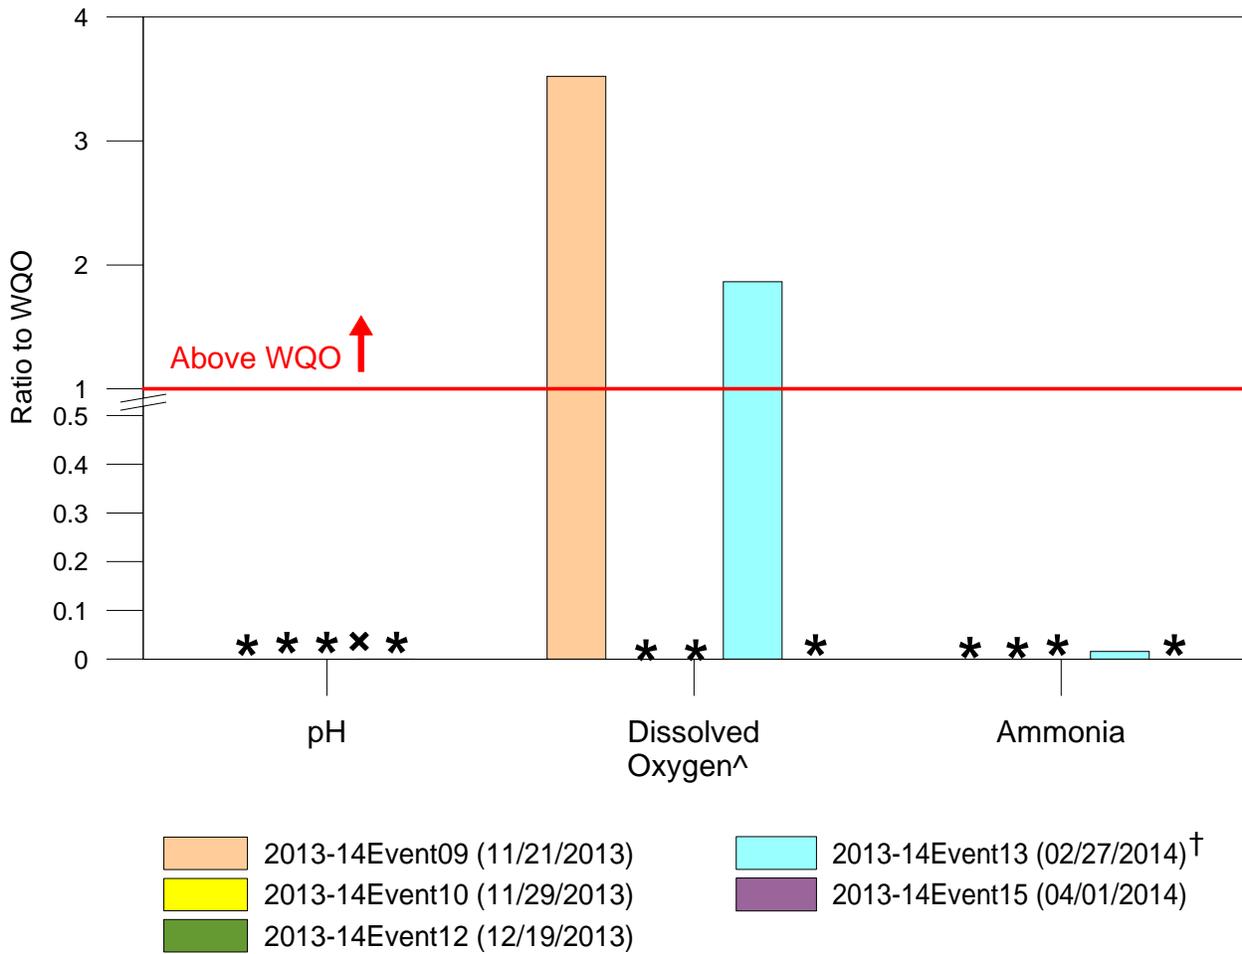

[^]Dissolved oxygen is an exceedance if ratio to WQO is below 1.

x pH was within WQO range.

***** Samples were not collected for ammonia, dissolved oxygen, or pH during Event 10, Event 12, and Event 15. Samples were not collected for ammonia and pH for Event 09.

[†] Dissolved oxygen and pH field measurements used for 2013-14Event13.

Figure 4-4.6 TS30 PD 728 at Foxfield Dr. Wet Weather Ratio Plots